



### Industrial Facilities (Non-Military)

## Basic Imagery Interpretation Brief

## Pao-chi Thermal Power Plant No. 2

## Pao-chi, China

25X1A

██████████

*Handle via Talent - Keyhole  
Channels Only*

**Top Secret**

DECLASS REVIEW by NIMA/DOD

BCS 13/0023/69  
TCS 9941/68  
DATE SEPTEMBER 1968  
COPY 93  
PAGES 2

## WARNING

This document contains information affecting the national security of the United States within the meaning of the espionage laws U. S. Code Title 18, Sections 793, 794.

The law prohibits its transmission or the revelation of its contents in any manner to an unauthorized person, as well as its use in any manner prejudicial to the safety or interest of the United States or for the benefit of any foreign government to the detriment of the United States. It is to be seen only by personnel especially indoctrinated and authorized to receive information in the designated control channels. Its security must be maintained in accordance with regulations pertaining to TALENT-KEYHOLE Control System.

GROUP 1 EXCLUDED FROM AUTOMATIC DOWNGRADING AND DECLASSIFICATION
---


DISPOSITION DATE(S)	STOCK	MINIMUM
Approved For Release 2001/09/04 : CIA-RDP79T00909A000100016104-7		

[illegible]

INSTALLATION OR ACTIVITY NAME					COUNTRY	
Pao-chi Thermal Power Plant No. 2					CH	
UTM COORDINATES		GEOGRAPHIC COORDINATES		BE NUMBER	COMIREX NO.	WAC-PIC NO.
48XP943027		34-21-30N 107-06-50E			None	0384-9I
MAP REFERENCE						
ACIC. US Air Target Chart 200 Sheet 0384-14A, 1st edition, Feb. 60, Scale 1:200,000 (SECRET)						
LATEST IMAGERY USED				NEGATION DATE (If required)		
				Not required		

#### INTRODUCTION

The Pao-chi Thermal Power Plant No. 2 is located 1.8 nautical miles (nm) southwest from the city of Pao-chi on the west bank of the Ching-chiang Ho (River). The Pao-chi Fabrication Industry is 1.1 nm southeast of the power plant.

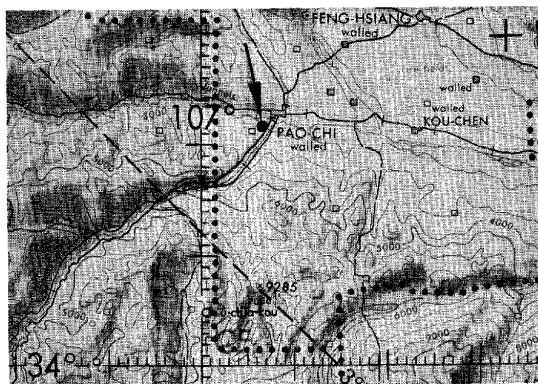

#### BASIC DESCRIPTION


The rail served power plant is located within a fenced area approximately 2,150 by 850 feet. The plant appeared to be operating on all available coverage.

The boilerhouse, generator hall, and the control house have been expanded since however, lack of frequent coverage precludes determination of exact completion date. A second cooling tower and a coal processing building have been added.

TOP SECRET RUFF

TCS - 9941/68

IMAGERY ANALYSIS SERVICE

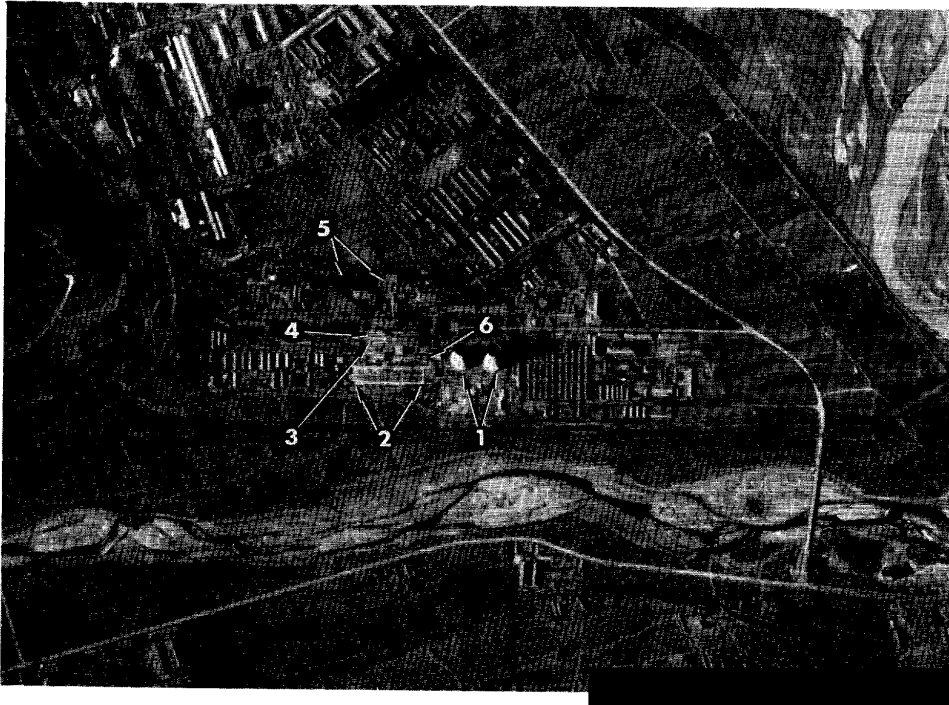


25X1D

Key to Annotations

<u>Item No.</u>	<u>Description</u>	<u>Measurements (ft)</u>	<u>Remarks</u>
1	Cooling Towers (2)	-	Natural-draft, One Operating
2	Switching Yard	-	Transformers not discernible
3	Generator Hall	335 x 75	No. of generators is
			undetermined
4	Boilerhouse	335 x 100	One stack
5	Coal Processing Facilities	-	-
6	Control House	350 x 35	-

25X1D

REFERENCES



Maps

ACIC. USAF Operational Navigation Chart, Sheet G-9, 2nd edition, Nov 60,  
Scale 1:1,000,000 (UNCLASSIFIED)

Documents

CIA/IAD. PIR 65122, Chinese Power Plants, Shensi Province, May 1966,  
TCS 2825/66 (TOP SECRET RUFF)


Requirement

EXSUBCOM -BR-N/002-69

TOP SECRET RUFF

**Top Secret**

Approved For Release 2001/09/04 : CIA-RDP79T00909A000100010104-7



**Top Secret**

Approved For Release 2001/09/04 : CIA-RDP79T00909A000100010104-7